

TP020 series Recommended Pitch 0.45 mm




Probe Standard Items


Unit:mm

TP020-NHC01-00


Needle Head 60°

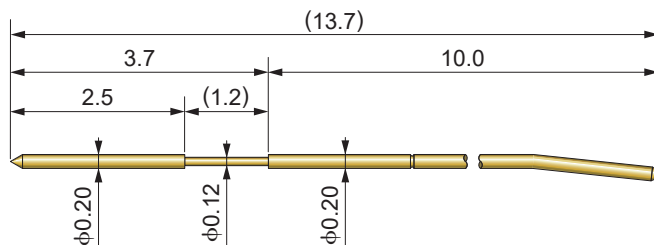

Probe Protruding Quantity when Inserting into RT020

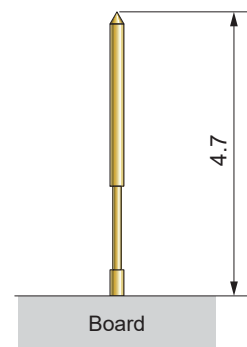


Stroke	1.2 mm	
Spring Force	3.46 gf	Preload
	6.52 gf	0.8 mm Recommended Stroke
Max. Current	1 A	
Parts Name	Material	Finish
Plunger	Steel	Au Plated
Barrel	Phosphor Bronze	Au Plated
Spring	Piano Wire	Au Plated

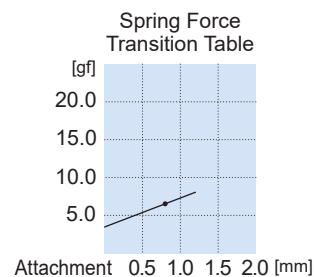


TP020-RHC01-00

Round Shaft Head



TP020-NBC01-00


Needle 60°



*Stroke Quantity 1.5mm

Correspondence Receptacle Standard Items

Unit:mm

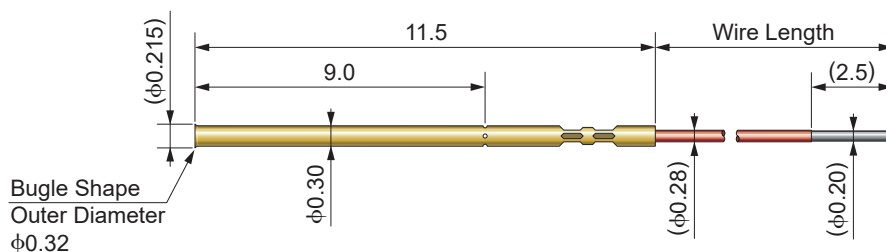

Wire Color	Product Name	Parts Name	Material	Finish
Red	RT020-RR00	Receptacle	Phosphor Bronze	Au Plated
Green	RT020-RG00	Wire	Polyurethane Copper Wire	
Wireless	RT020-RA00			

● All specifications are subject to change without notice.

TAISEI Co.,Ltd. Head Office Sales Dept.

Address : 6972 Shimo-Yoshida, Chichibu-shi, Saitama-ken, 369-1593, JAPAN.

Phone : +81-494-77-1211 / FAX : +81-494-77-1415

Sales Office **MKT TAISEI Co.,Ltd.**

Address : 3-10-8, Nohagi 1st Bldg, Minami-Ikebukuro, Toshima-ku, Tokyo, 171-0022, Japan.

Phone : +81-3-3982-0029 / FAX : +81-3-3986-1537

Web Site : <http://www.mkt-taisei.co.jp/>

e-tp020-03